


KEYED NOTES:

- ① LANL MSS U&I WILL NUMBER (METAL STAMP) THE HYDRANT AND VALVE BOX LID.
- ② PAINT HYDRANT BONNET BLACK AND ATTACH LABEL - CAUTION: NON-POTABLE WATER, DO NOT DRINK. [REQUIRED ONLY FOR HYDRANTS SERVED BY NON-POTABLE WATER ON DEDICATED FIRE LOOPS.]

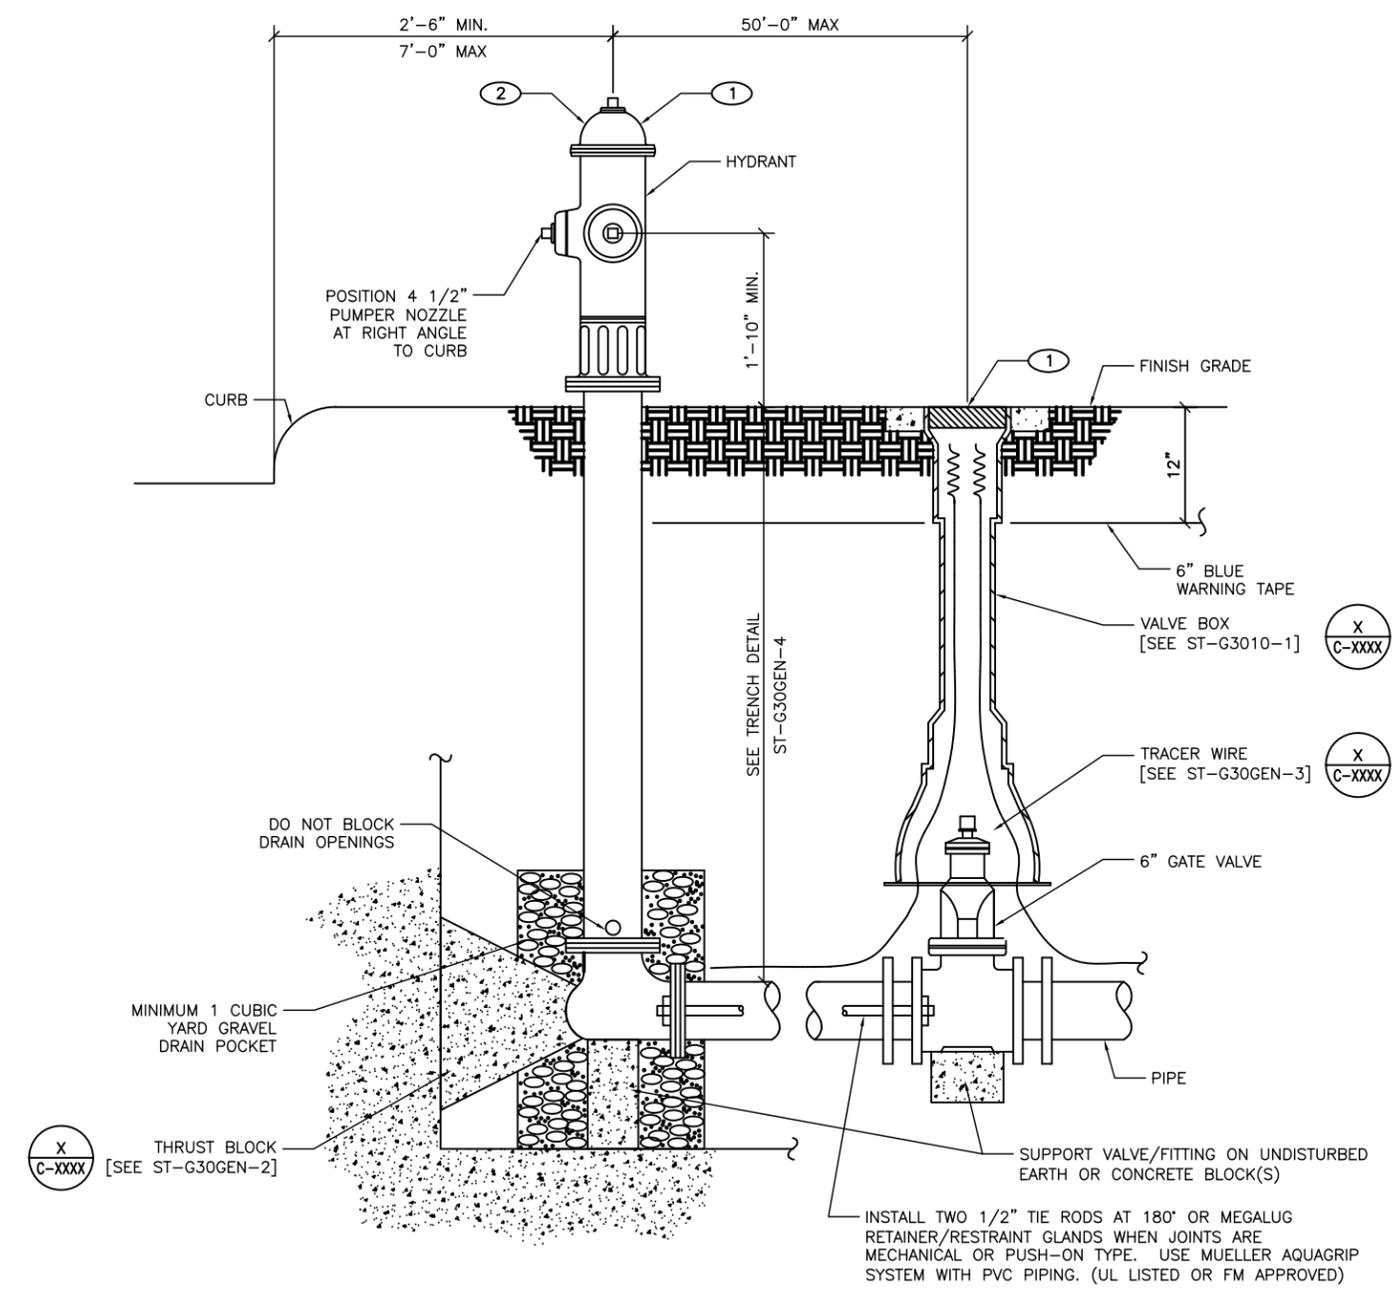

FIRE HYDRANT DETAIL
SCALE: NONE

DRAWING DEVELOPED FOR ML-3/ML-4 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

NOTES FOR DESIGNER:
(DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)
1. SEE SHEET 2.

NO	DATE	CLASS REV	DC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
3	1-28-14	U		GENERAL REVISION	KT	MS	JG	RT	TO
2	1-18-06	U	DY	REVISED TITLE BLOCK DATA, AND ADTS - ENGINEERING LOGO.	RP	EH	MS	EH	TO
1	8/23/02	U		GENERAL REVISION AND DWG. NO. WAS ST6110.	RP	EH	MS	EH	TO

ENGINEERING STANDARDS PROGRAM

ENGINEERING STANDARDS MANUAL

DRAWN	R.PEARSON
DESIGN	E.HOTH
CHECKED	M.SMITHOUR
DATE	6-28-99

TA-XX FIRE HYDRANT GATE SHUT-OFF VALVE DETAIL BLDG XXX SHEET 1

DISCIPLINE POC: EDWARD HOTH STANDARDS MANAGER: TOBIN ORUCH

1 OF 2

Los Alamos NATIONAL LABORATORY PO Box 1663 Los Alamos, New Mexico 87545

D.C.: UNCLASSIFIED	REVIEWER: LARRY BAYS	BASIS: BASIS	DATE:
PROJECT ID	DRAWING NO	ESR NO.:	REV
CHAPTER 3	ST-G3010-4	ESR #	3