


C:\LANL\Eng Standards\Eng. Manual [LEM]\2. Approved\SI-G3020-2C2.r5.dwg, 01/28/05 @ 15:29 093598

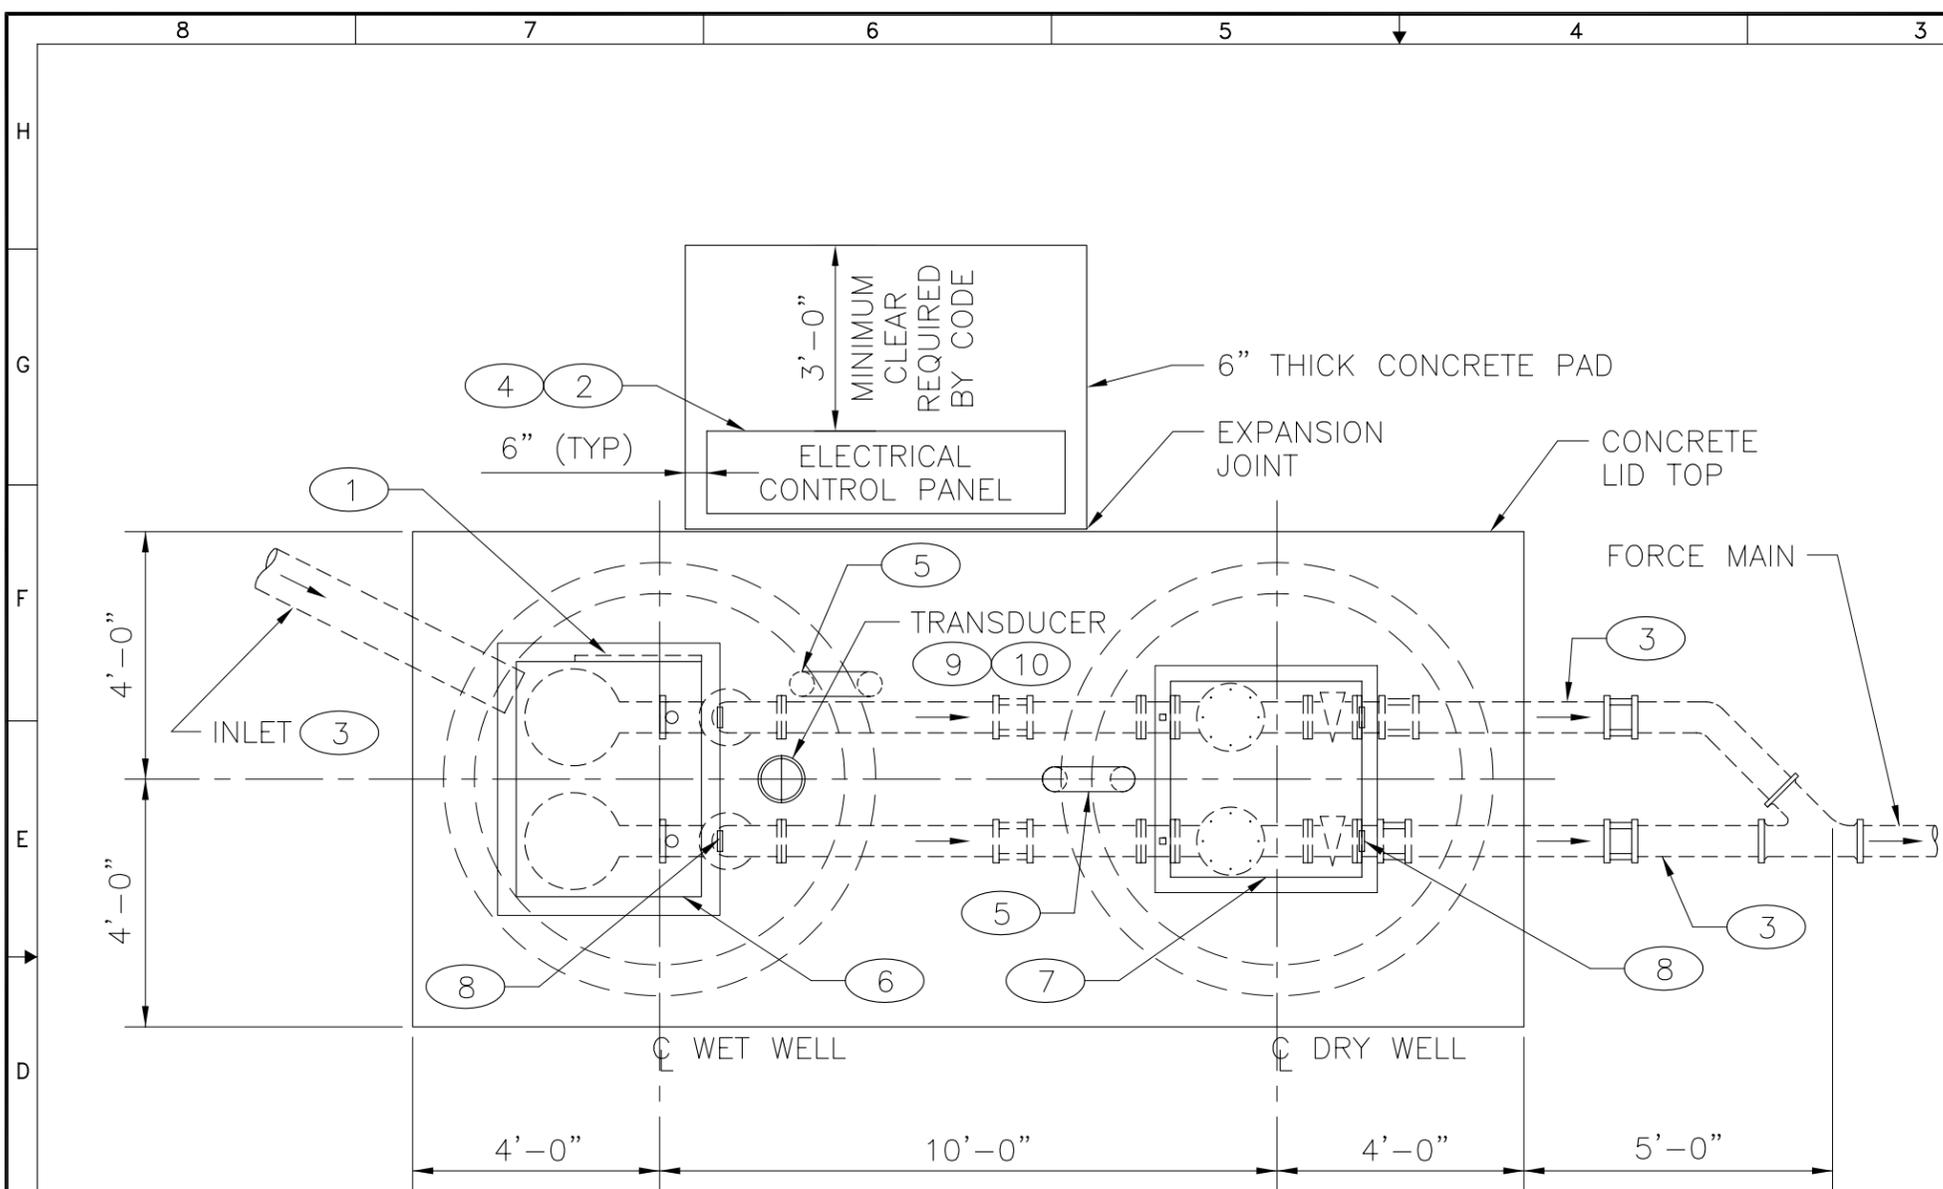

KEYED NOTES:

- ① LOCATE CABLE RACK ON SAME SIDE OF CONTROL PANEL, DO NOT LOCATE TRANSDUCER AND FLOAT IN DIRECT LINE WITH INLET AND DISCHARGE LINES.
- ② LOCATE TOP OF ELECTRICAL CONTROL PANEL 6 FEET ABOVE CONCRETE PAD.
- ③ DUCTILE IRON PIPE.
- ④ LOCATION OF ALARM BEACON WITH FLASHER SHALL BE VISIBLE TO ROAD TRAFFIC AND NOT BEHIND BUILDING OR IN LOW AREA.
- ⑤ VENT PIPE.
- ⑥ 48" X 36" HINGED ACCESS DOOR AND FRAME WITH HINGED SAFETY GRATING (FURNISHED WITH PUMP).
- ⑦ 36" X 36" HINGED ACCESS DOOR AND FRAME (FURNISHED WITH PUMP).
- ⑧ ACCESS DOOR HINGES (TYP.)
- ⑨ SEE ELECTRICAL DETAIL [SHEET 4].
- ⑩ LOCATE TO PROVIDE CLEAR SPACE BELOW FOR INSTALLATION OF 6" PVC STILLING WELL TO BASE OF WET WELL LANL's SSS WILL FURNISH AND INSTALL STILLING WELL.

LIFT STATION PLAN

SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

- 1. SEE SHEET 4.
- 2. VERIFY ALL PUMP HARDWARE DIMENSIONS FOR OPENING LOCATIONS AND PLACEMENT OF HARDWARE WITH PUMP MANUFACTURER.
- 3. LOCATION AND ORIENTATION OF CONTROL PANEL TO BE APPROVED BY FWO-UI (UTILITIES GROUP).

DRAWING DEVELOPED FOR ML-3/ML-4 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE)

NO	DATE	CLASS REV	ADC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
5	1-27-05	U	DY	REVISED TITLEBLOCK REVISION DATA, AND ADTS - ENGINEERING LOGO.	RP	EH	RT	EH	TO
4	8-16-04	U		REVISED TITLE	RP	EH	MS	EH	TO
3	8-26-03	U		REVISED LOCATION OF WET WELL DOOR HINGERS AND VENT PIPE. DWG NO. WAS ST3710.	RP	EH	MS	EH	TO
2	12-16-02	U		REMOVED DROP INLET PIPE.	RP	EH	DC	EH	TO
1	6-5-02	U		DRAWING REVISED AND TRANSFERRED TO CIVIL CHAPTER. DWG No. WAS ST6010, CHAPTER 6.	RP	EH	MT	EH	TO

ADTS - ENGINEERING DIVISION

ENGINEERING STANDARDS MANUAL

EXTERIOR SEWAGE LIFT STATION

BLDG X SUBMITTED	TA-X APPROVED FOR RELEASE
DISCIPLINE POC: GURINDER GREWAL	STANDARDS MANAGER: TOBIN DRUCH
DATE: 6-28-99	SHEET: 2
2 OF 4	
CLASSIFICATION: U PROJECT ID	REVIEWER: LARRY BAYS DRAWING NO
CHAPTER 3 ST-G3020-2	
	REV 5

Los Alamos NATIONAL LABORATORY
PO Box 1663
Los Alamos, New Mexico 87545