


D
C
B
A

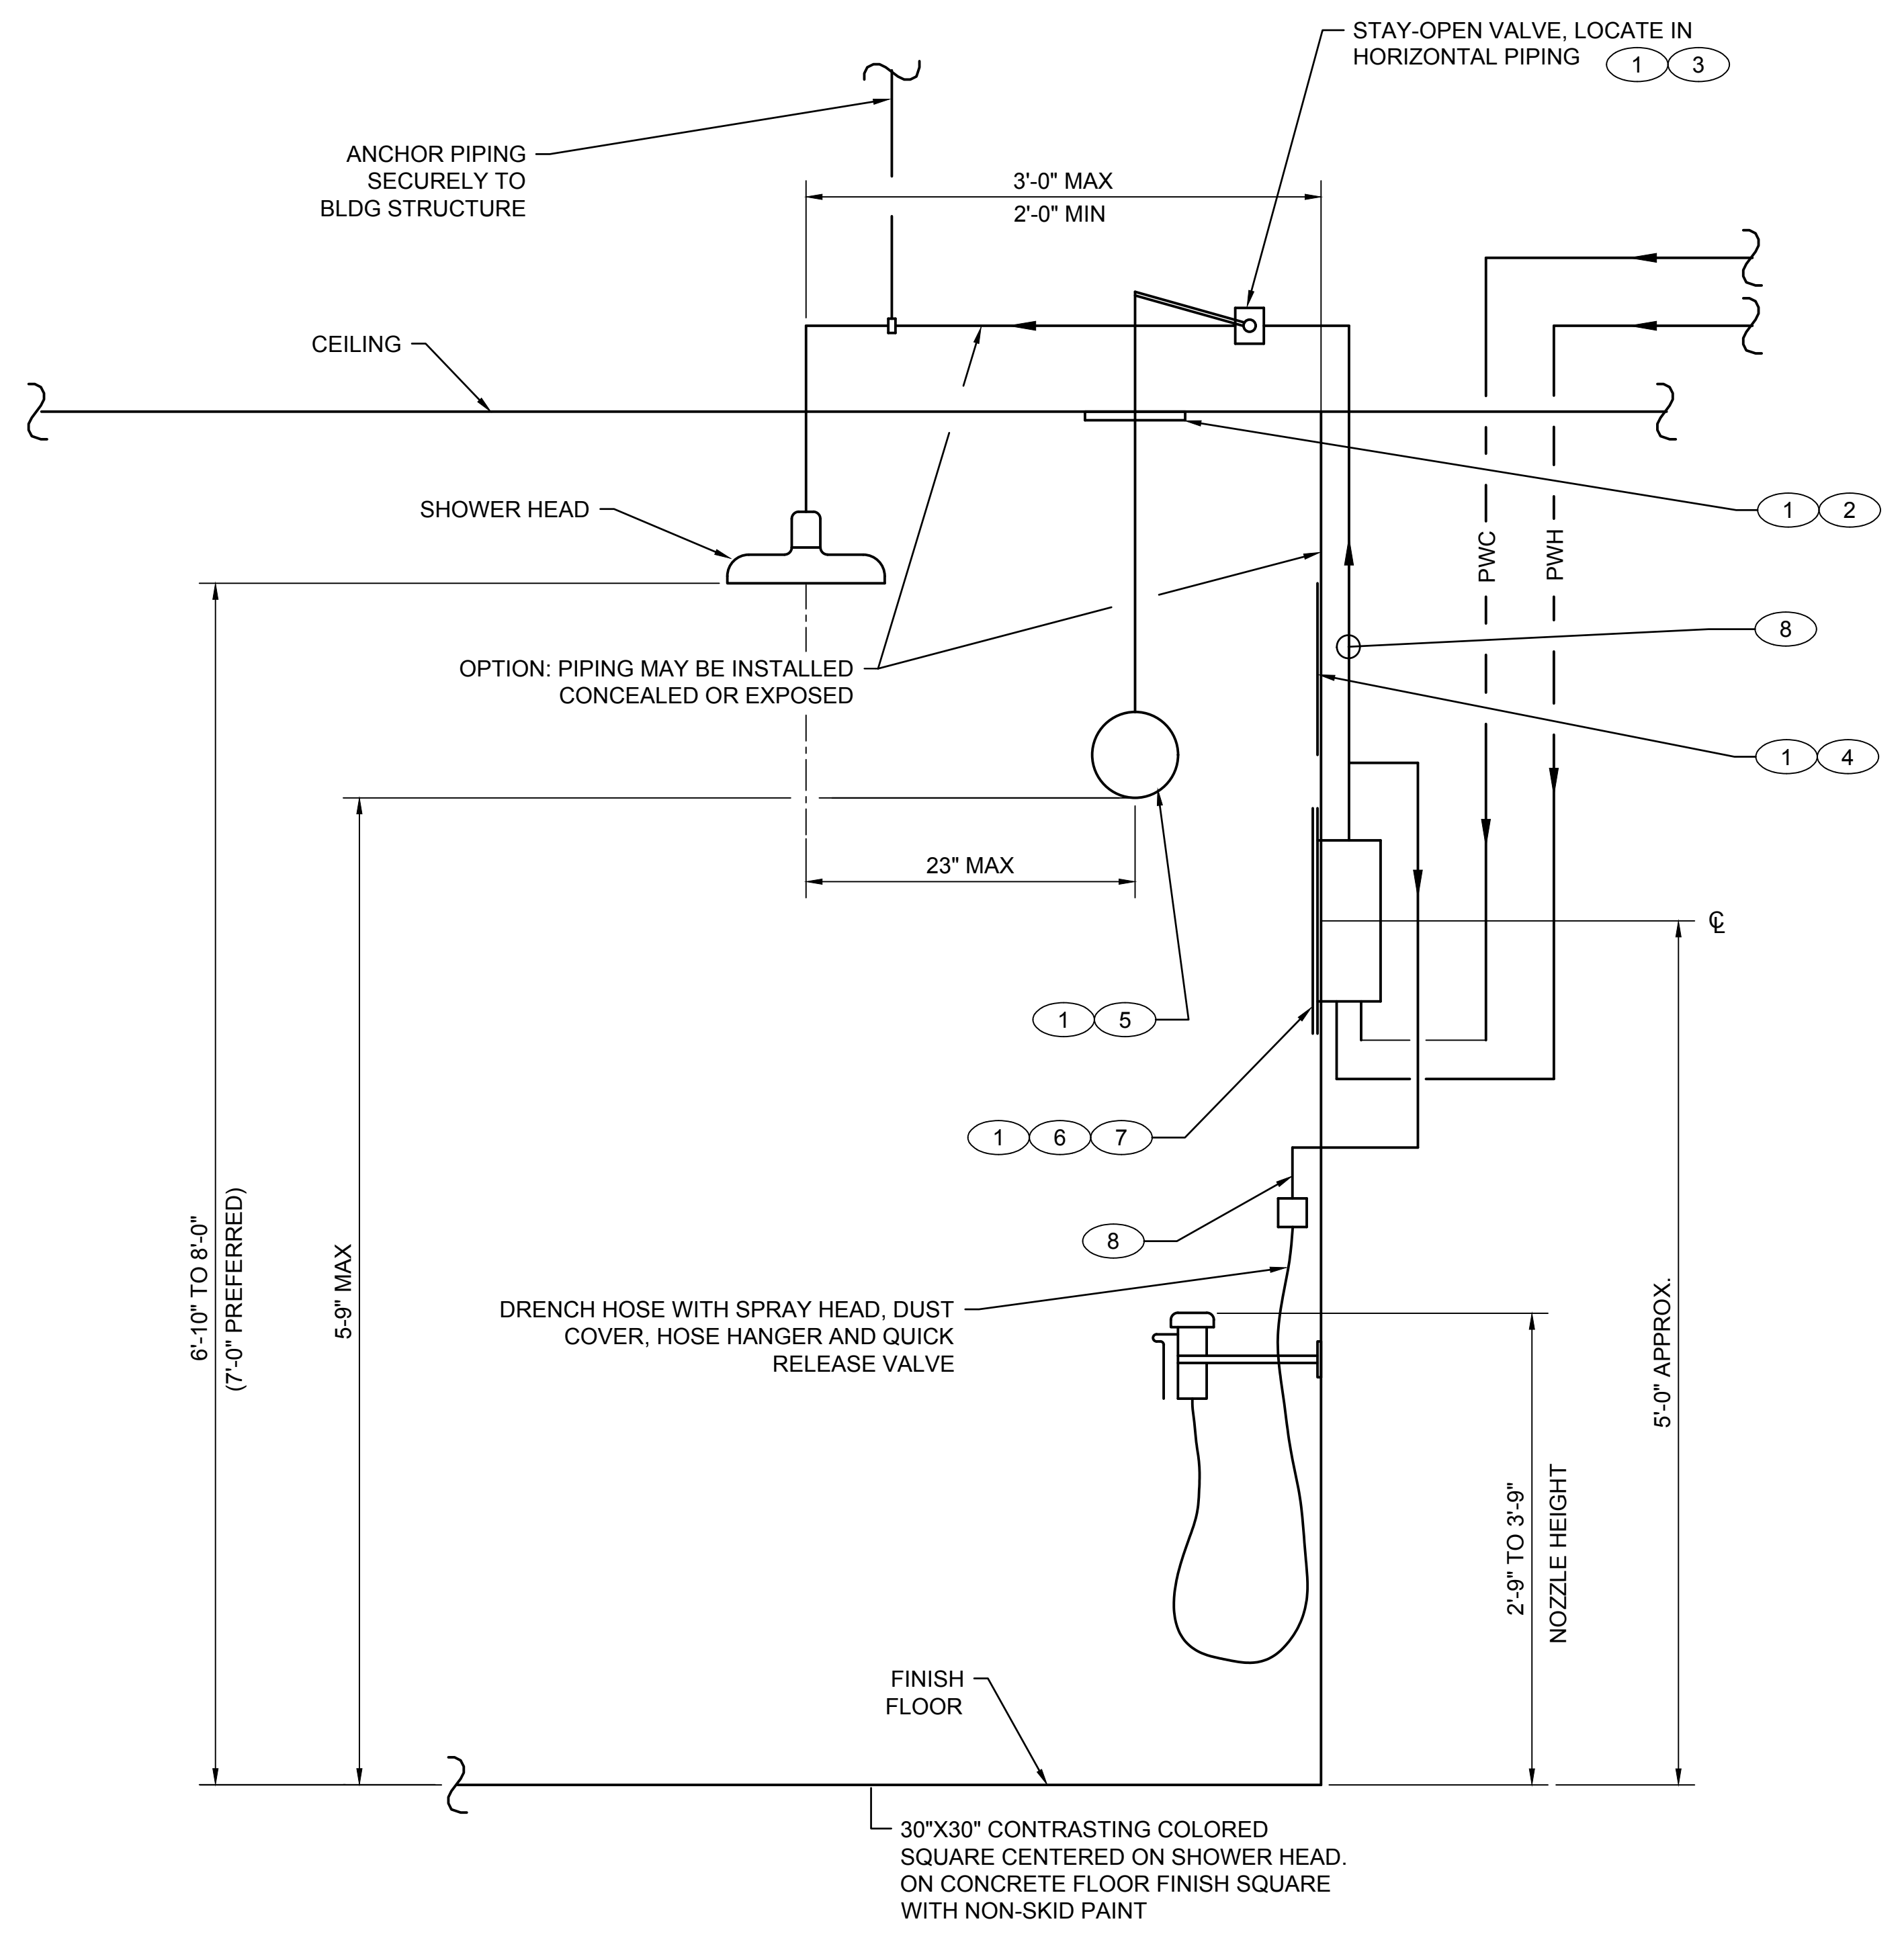

KEYED NOTES:

- 1 FURNISHED WITH EMERGENCY EQUIPMENT.
- 2 PROVIDE GUIDE PLATE WHEN PULL ROD PENETRATES CEILING.
- 3 VALVE TO BE ACCESSIBLE FOR MAINTENANCE.
- 4 EMERGENCY SIGN(S).
- 5 LOCATE PULL ROD AS CLOSE TO WALL AS POSSIBLE.
- 6 THERMOSTATIC MIXING VALVE IN CABINET W/ DOOR, WALL OR RECESSED MOUNTED.
- 7 LOCATE ISOLATION BALL VALVES (3 REQ'D) WITHIN CABINET.
- 8 TEPID WATER SUPPLY.

DRAWING DEVELOPED FOR ML-3/ ML-4 PROJECTS. FOR ML-1/ ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

SAFETY SHOWER WITH DRENCH HOSE DETAIL
SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)
1. SEE SHEET 4.

NO	DATE	CLASS REV	DC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
3	06-15-2017	UNCLASS	TO	ADMIN. CHANGES TO CAD STD. REV#5 FORMAT & SHEET NUMBER WAS 1 OF 5	JB	AJ	ML	ML	TO
2	08-14-03	U	LB	EDITORIAL CHANGES & DWG NO. WAS ST6000	RP	JM	RR	GG	TO
1	09-06-02	U	LB	GENERAL REVISION ADDED PWH PIPING AND MIXING VALVE	RP	RR	GG	GG	TO

ENGINEERING STANDARDS

MECHANICAL

**EMERGENCY EQUIPMENT DETAIL
SAFETY SHOWER WITH DRENCH HOSE**

DRAWN	R. PEARSON
DESIGN	R. ROMERO
CHECKED	G. GREWAL
DATE	06-28-99

TA- XX BLDG- XX

SUBMITTED DISCIPLINE POC: GURINDER GREWAL APPROVED FOR RELEASE STANDARDS MANAGER: TOBIN ORUCH

SHEET **1** OF **4**

D.C.: U REVIEWER: LARRY BAYS DATE: 06-28-99

PROJECT ID DRAWING NO **CHAPTER 6 ST-D2010-1** REV **3**

00% REVIEW
NOT FOR CONSTRUCTION