



G:\LANL Engineering Standards\Emp. Manual [LEM]\V. Approved\ST-02010-1ML23.dwg, 09/18/03 @ 14:14 033598

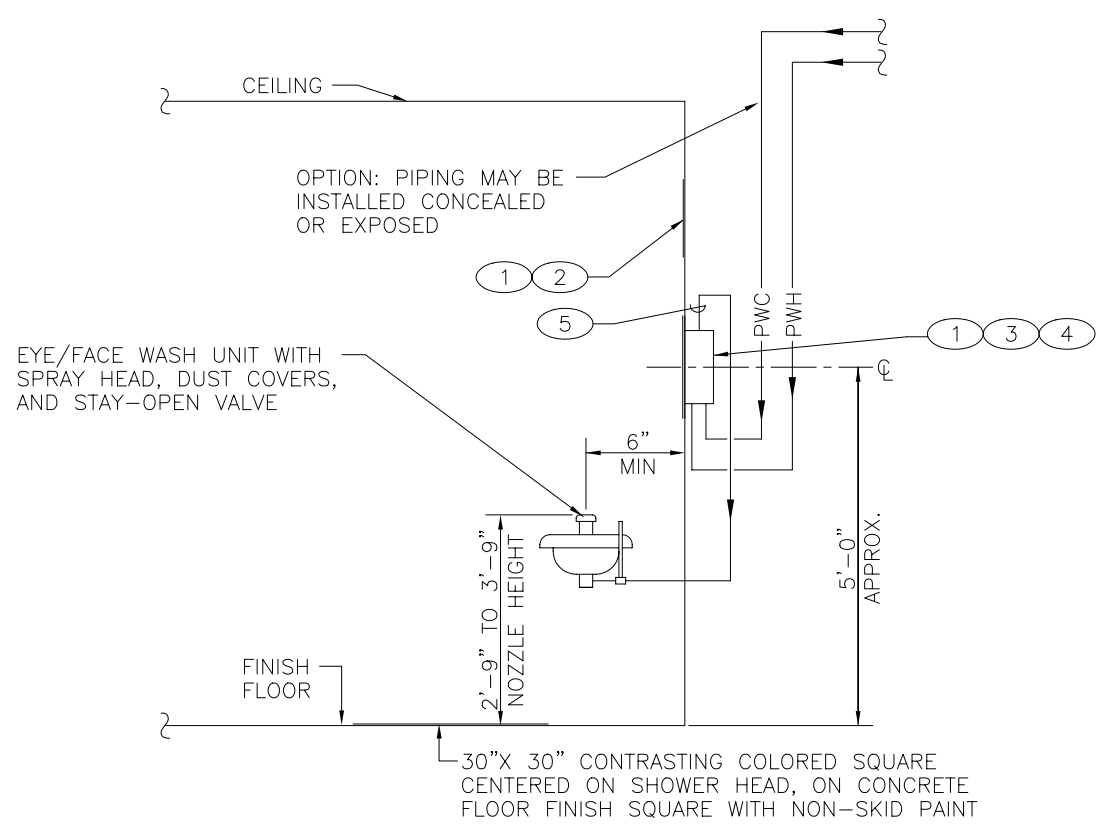

EYEWASH DETAIL

SCALE: NONE



NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

1. SEE SHEET 4 AND 5.

KEYED NOTES:

- ① FURNISHED WITH EMERGENCY EQUIPMENT.
- ② EMERGENCY SIGN(S).
- ③ THERMOSTATIC MIXING VALVE IN CABINET W/ DOOR, OR RECESSED MOUNTED.
- ④ LOCATE ISOLATION BALL VALVES (3 REQ'D) WITHIN CABINET.
- ⑤ TEPID WATER SUPPLY.

DRAWING DEVELOPED FOR ML-3/ML-4 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

3	8-14-03	U	EDITORIAL CHANGES & DWG NO. WAS ST6000.	RP	JM	RR	GG	TO
2	10-25-02	U	REMOVED THE EYEWASH DRAIN PIPING.	RP	JM	RR	GG	TO
1	9-6-02	U	GENERAL REVISION, ADDED PWH PIPING AND MIXING VALVE.	RP	RR	GG	GG	TO
NO	DATE	CLASS REV	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP



FACILITY & WASTE OPERATIONS
DESIGN ENGINEERING CONSTRUCTION SERVICES

ENGINEERING STANDARDS MANUAL		DRAWN	R. PEARSON
EMERGENCY EQUIPMENT DETAIL EYEWASH		DESIGN	R. ROMERO
		CHECKED	G. GREWAL
		DATE	6-28-99
BLDG X	TA-X	APPROVED FOR RELEASE	
DISCIPLINE POC: GURINDER GREWAL		STANDARDS MANAGER: TOBIN ORUCH	
		SHEET	3
		3	OF 5
CLASSIFICATION U	REVIEWER LARRY BAYS	DATE	
PROJECT ID	DRAWING NO	DATE	REV
CHAPTER 6	ST-D2010-1		3



PO Box 1663
Los Alamos, New Mexico 87545