



GENERAL NOTES:

- SEE SHEET ST6700.4 FOR DESIGN NOTES.

KEYED NOTES:


- ① TEST SECTION MANIFOLD (SHIPPED LOOSE) TO BE INSTALLED BY CONTRACTOR
- ② FOR FILTER  SEE DETAIL
PRESSURE DROP GAUGES [SEE ST6700.4]

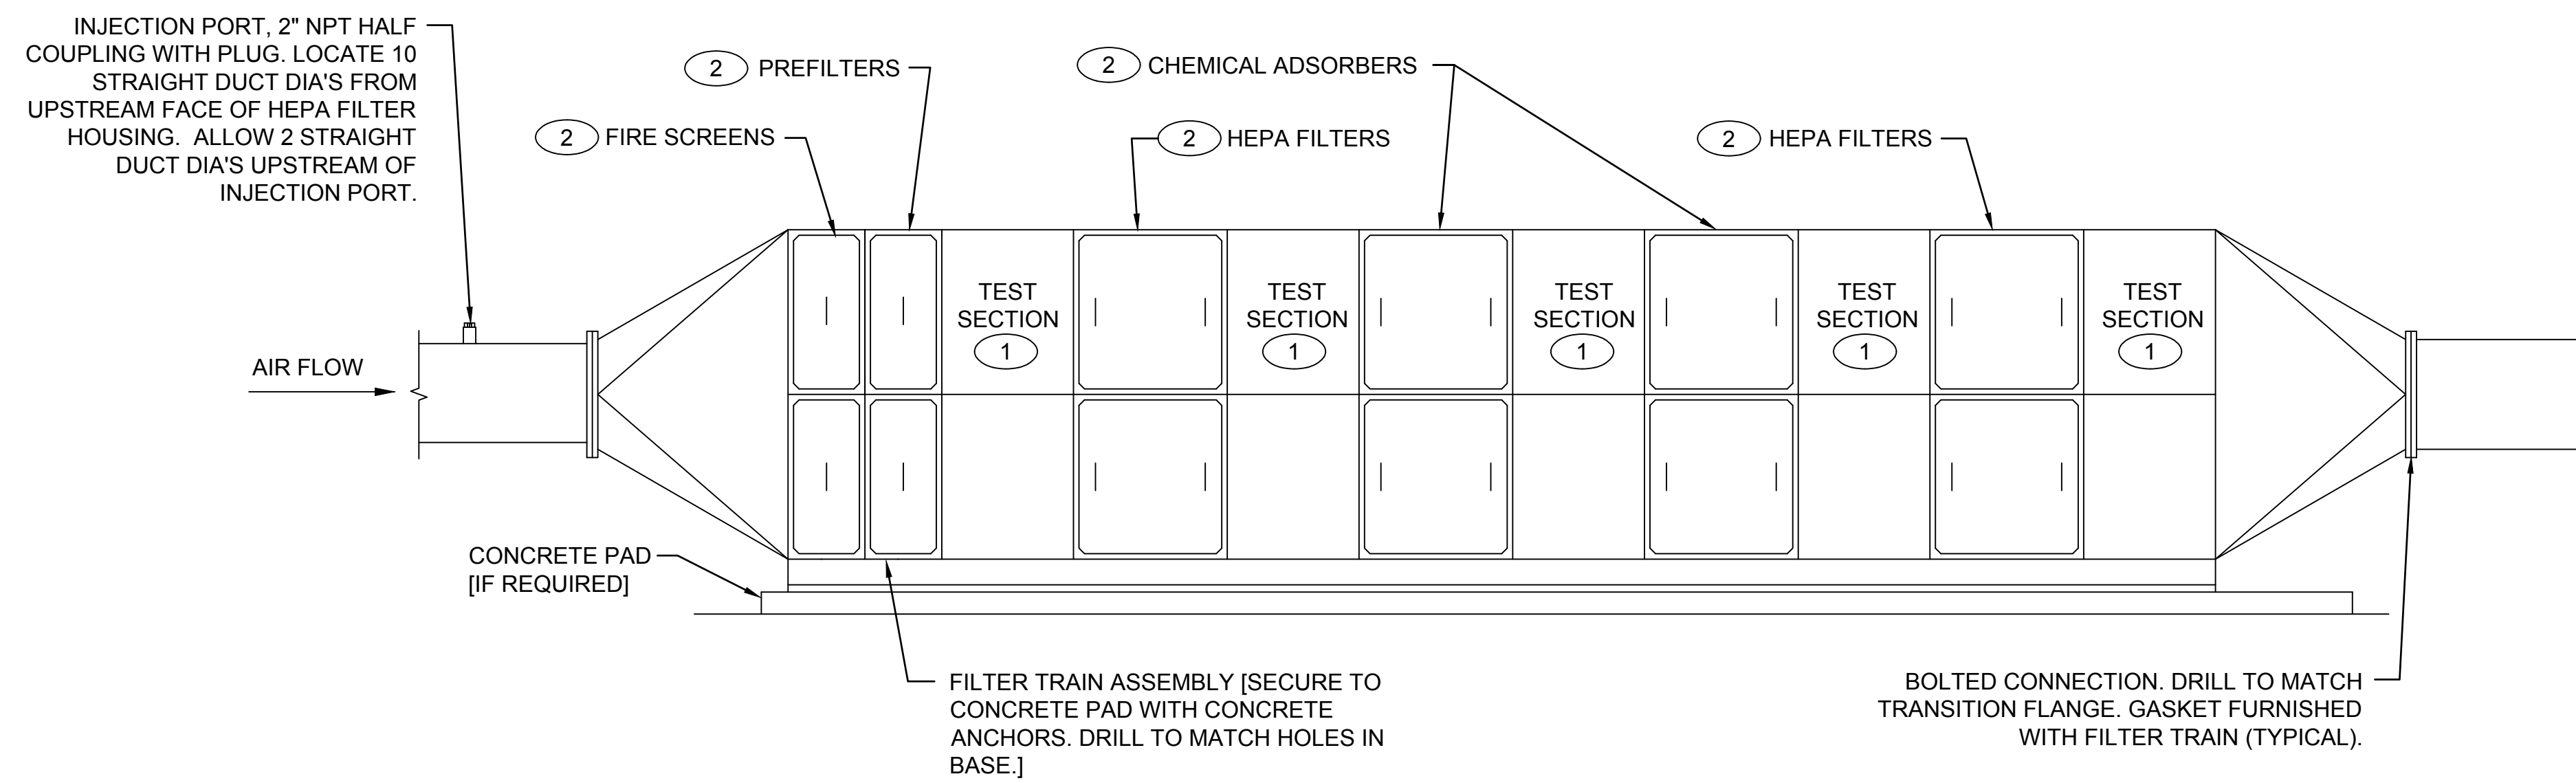

DRAWING DEVELOPED FOR ML-3/ML-4 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

 **FILTER TRAIN DETAIL** (2 HIGH X 2 WIDE)
SCALE: NONE

00% REVIEW
NOT FOR CONSTRUCTION

1	05-11-2017	UNCLASS	ML	ADMIN. CHANGES TO CAD STD. REV#8 FORMAT	JB	ML	AJ	ML	TO
NO	DATE	CLASS REV	DC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
ENGINEERING STANDARDS									
MECHANICAL								DRAWN	
FILTER TRAIN BAG-OUT HOUSING. TWO STAGE HEPA FILTERS WITH CHEMICAL ADSORBERS								DESIGN	
TA- XX								CHECKED	
SUBMITTED								DATE	6-28-99
APPROVED FOR RELEASE DISCIPLINE POC: DANNY NGUYEN								BLDG XX	
								SHEET M3	
P0 Box 1663 Los Alamos, New Mexico 87545								3 OF 4	
D.C.: U		REVIEWER: DANNY NGUYEN				DATE:			
PROJECT ID		DRAWING NO				DATE:		REV	
XXXXXX		ST6700.3						1	