


D
C
B
A

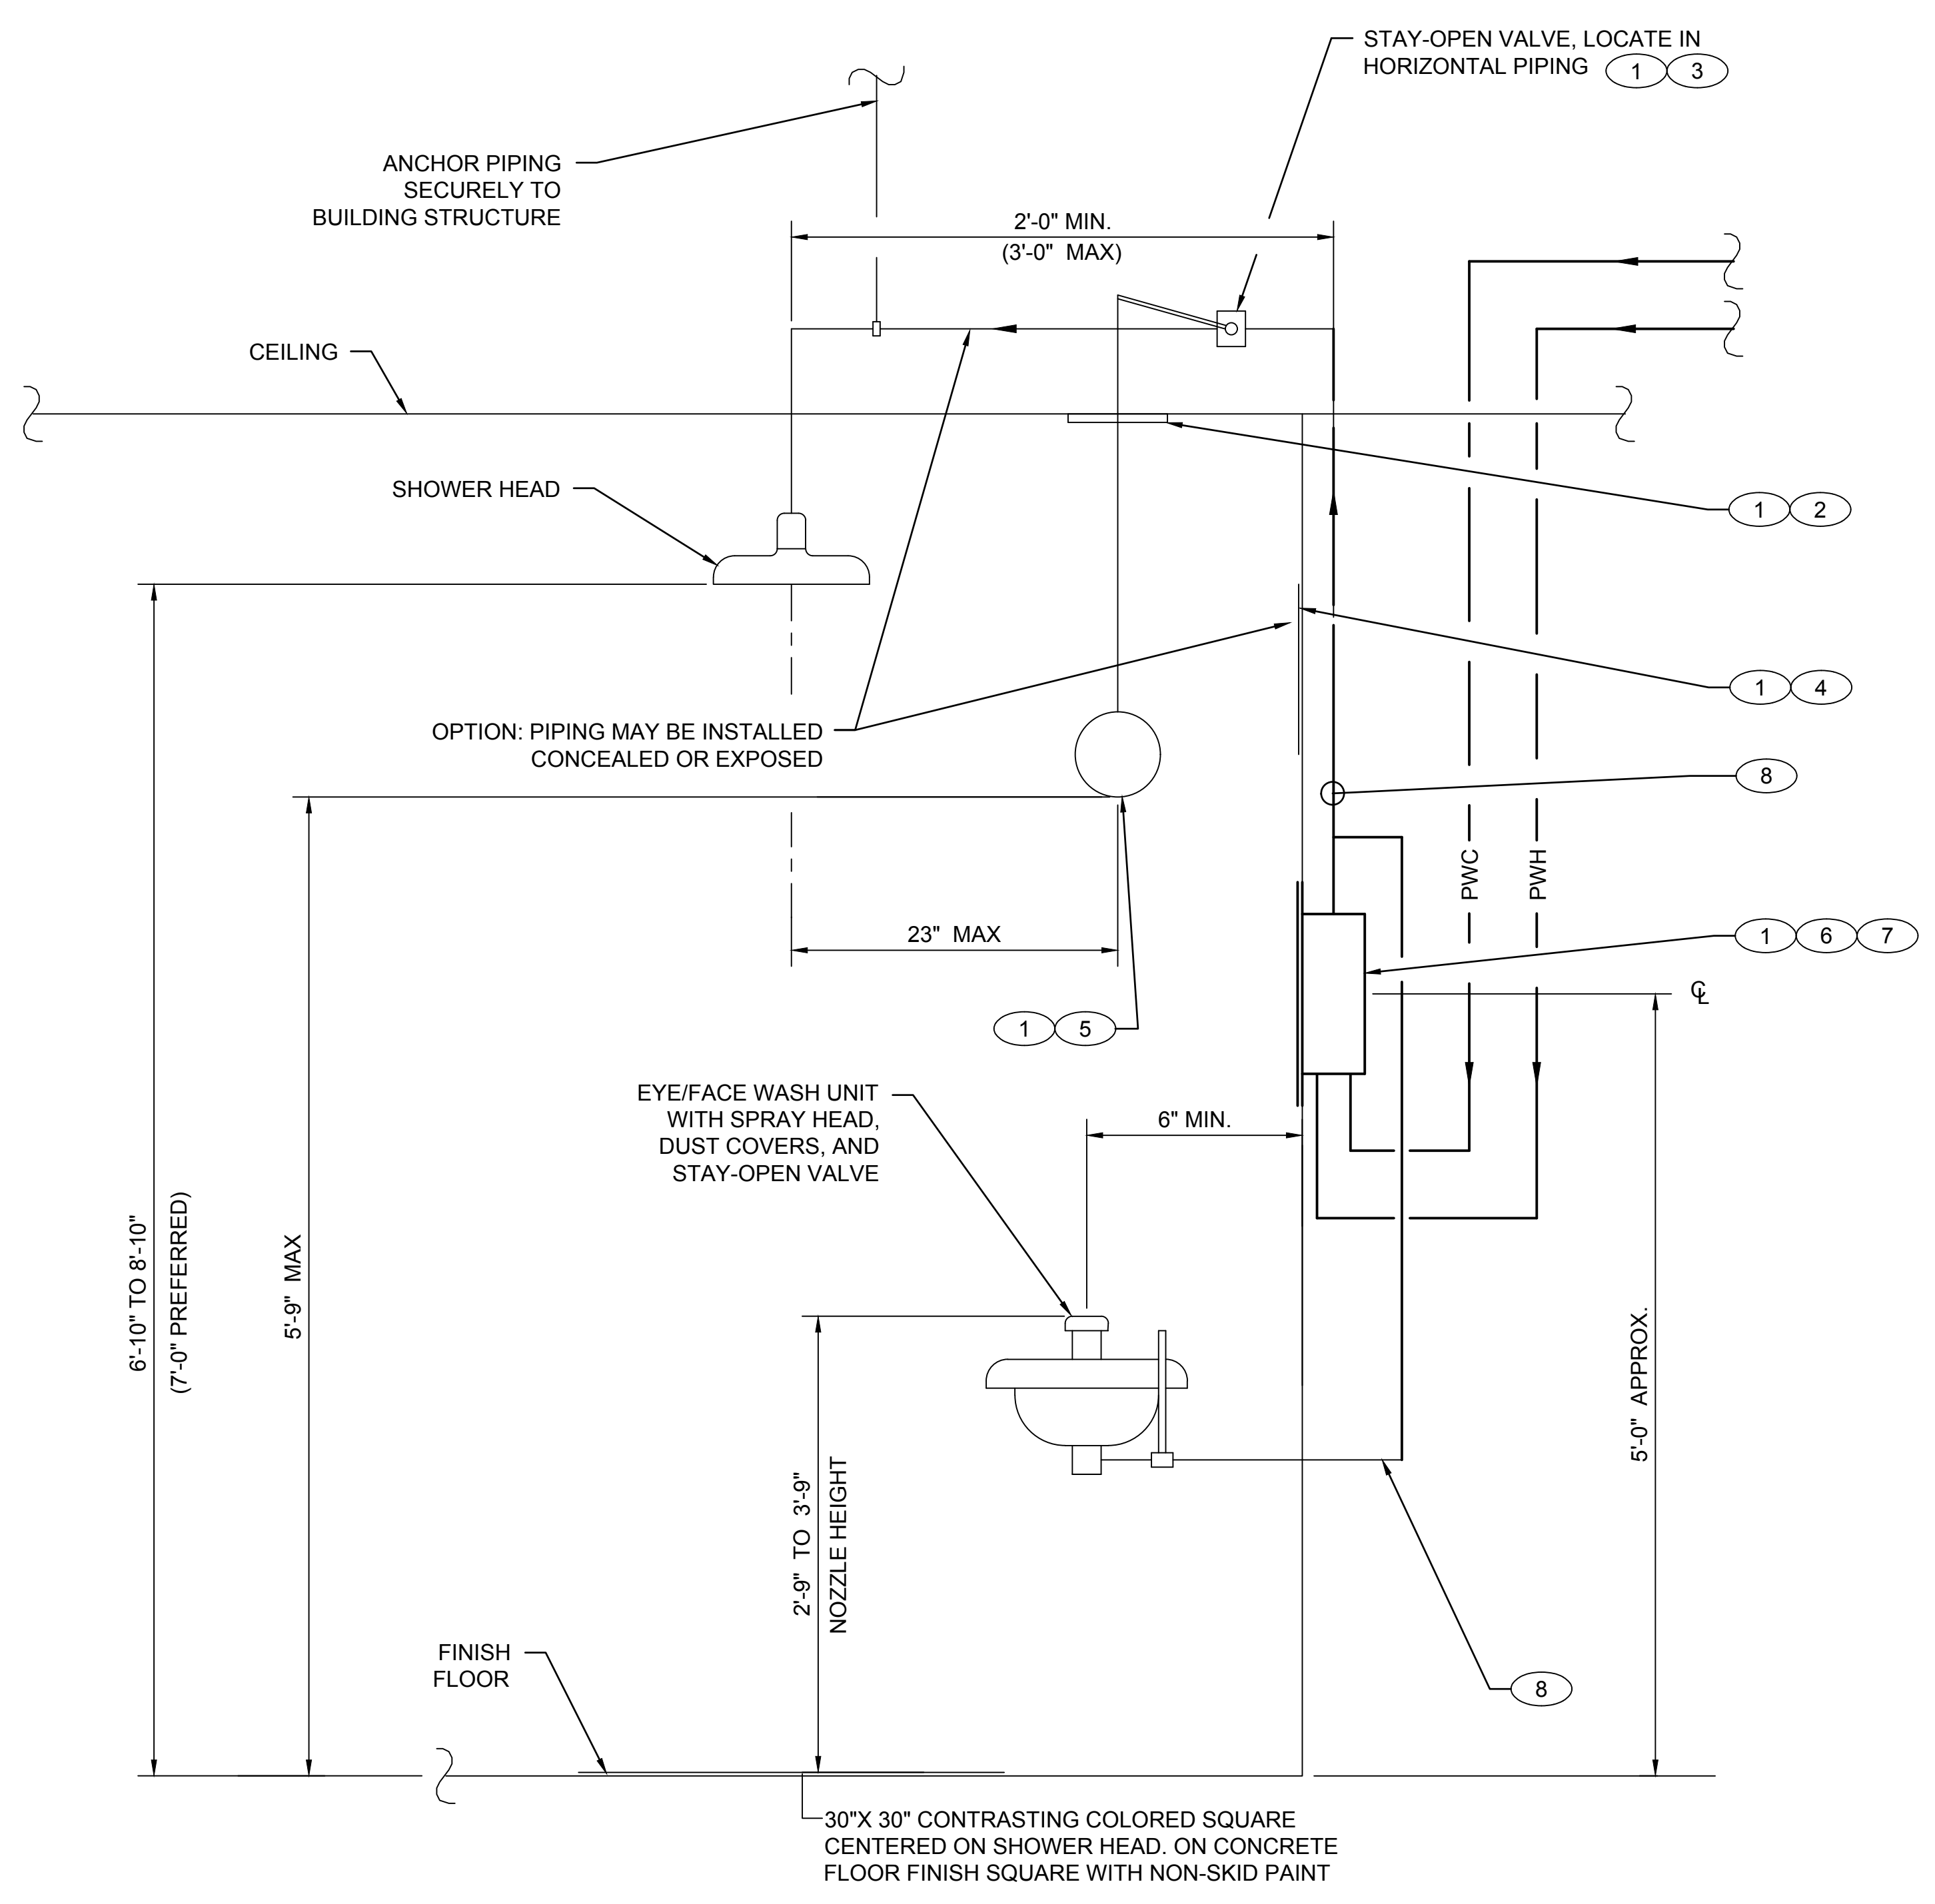

- KEYED NOTES:**
- ① FURNISHED WITH EMERGENCY EQUIPMENT.
 - ② PROVIDE GUIDE PLATE WHEN PULL ROD PENETRATES CEILING.
 - ③ VALVE TO BE ACCESSIBLE FOR MAINTENANCE.
 - ④ EMERGENCY SIGN(S).
 - ⑤ LOCATE PULL ROD AS CLOSE TO WALL AS POSSIBLE.
 - ⑥ THERMOSTATIC MIXING VALVE IN CABINET W/ DOOR, WALL OR RECESSED MOUNTED.
 - ⑦ LOCATE ISOLATION BALL VALVES (3 REQ'D) WITHIN CABINET.
 - ⑧ TEPID WATER SUPPLY.

DRAWING DEVELOPED FOR ML-3/ ML-4 PROJECTS. FOR ML-1/ ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

SAFETY SHOWER WITH EYEWASH DETAIL

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)
SEE SHEET 4.

| NO | DATE | CLASS REV | DC | DESCRIPTION | DWN | DSGN | CHKD | SUB | APP |
|----|------------|-----------|----|---|-----|------|------|-----|-----|
| 4 | 06-15-2017 | UNCLASS | TO | ADMIN. CHANGES TO CAD STD. REV#5 FORMAT & SHEET NUMBER WAS 2 OF 5 | JB | AJ | ML | ML | TO |
| 3 | 08-14-2003 | U | LB | EDITORIAL CHANGES & DWG. NO. WAS ST6900 | RP | JM | RR | GG | TO |
| 2 | 10-25-2002 | U | LB | REMOVED THE EYEWASH DRAIN PIPING | RP | RR | GG | GG | TO |
| 1 | 09-06-2002 | U | LB | GENERAL REVISION ADDED PWH PIPING AND MIXING VALVE | RP | RR | GG | GG | TO |

ENGINEERING STANDARDS

MECHANICAL

**EMERGENCY EQUIPMENT DETAIL
SAFETY SHOWER WITH EYEWASH**

| | |
|---------|------------|
| DRAWN | R. PEARSON |
| DESIGN | R. ROMERO |
| CHECKED | G. GREWAL |
| DATE | 06-28-1999 |

TA- XX BLDG- XX

SUBMITTED DISCIPLINE POC: GURINDER GREWAL APPROVED FOR RELEASE STANDARDS MANAGER: TOBIN ORUCH

SHEET **2**

2 OF **4**

D.C.: U REVIEWER: LARRY BAYS DATE: 06-28-1999

PROJECT ID DRAWING NO DATE: 06-28-1999

CHAPTER 6 ST-D2010-1 REV **4**

00% REVIEW
NOT FOR CONSTRUCTION