


D  
C  
B  
A

- KEYED NOTES:**
- ① FURNISHED WITH EMERGENCY EQUIPMENT.
  - ② EMERGENCY SIGN(S).
  - ③ THERMOSTATIC MIXING VALVE IN CABINET W/ DOOR, OR RECESSED MOUNTED.
  - ④ LOCATE ISOLATION BALL VALVES (3 REQ'D) WITHIN CABINET.
  - ⑤ TEPID WATER SUPPLY.

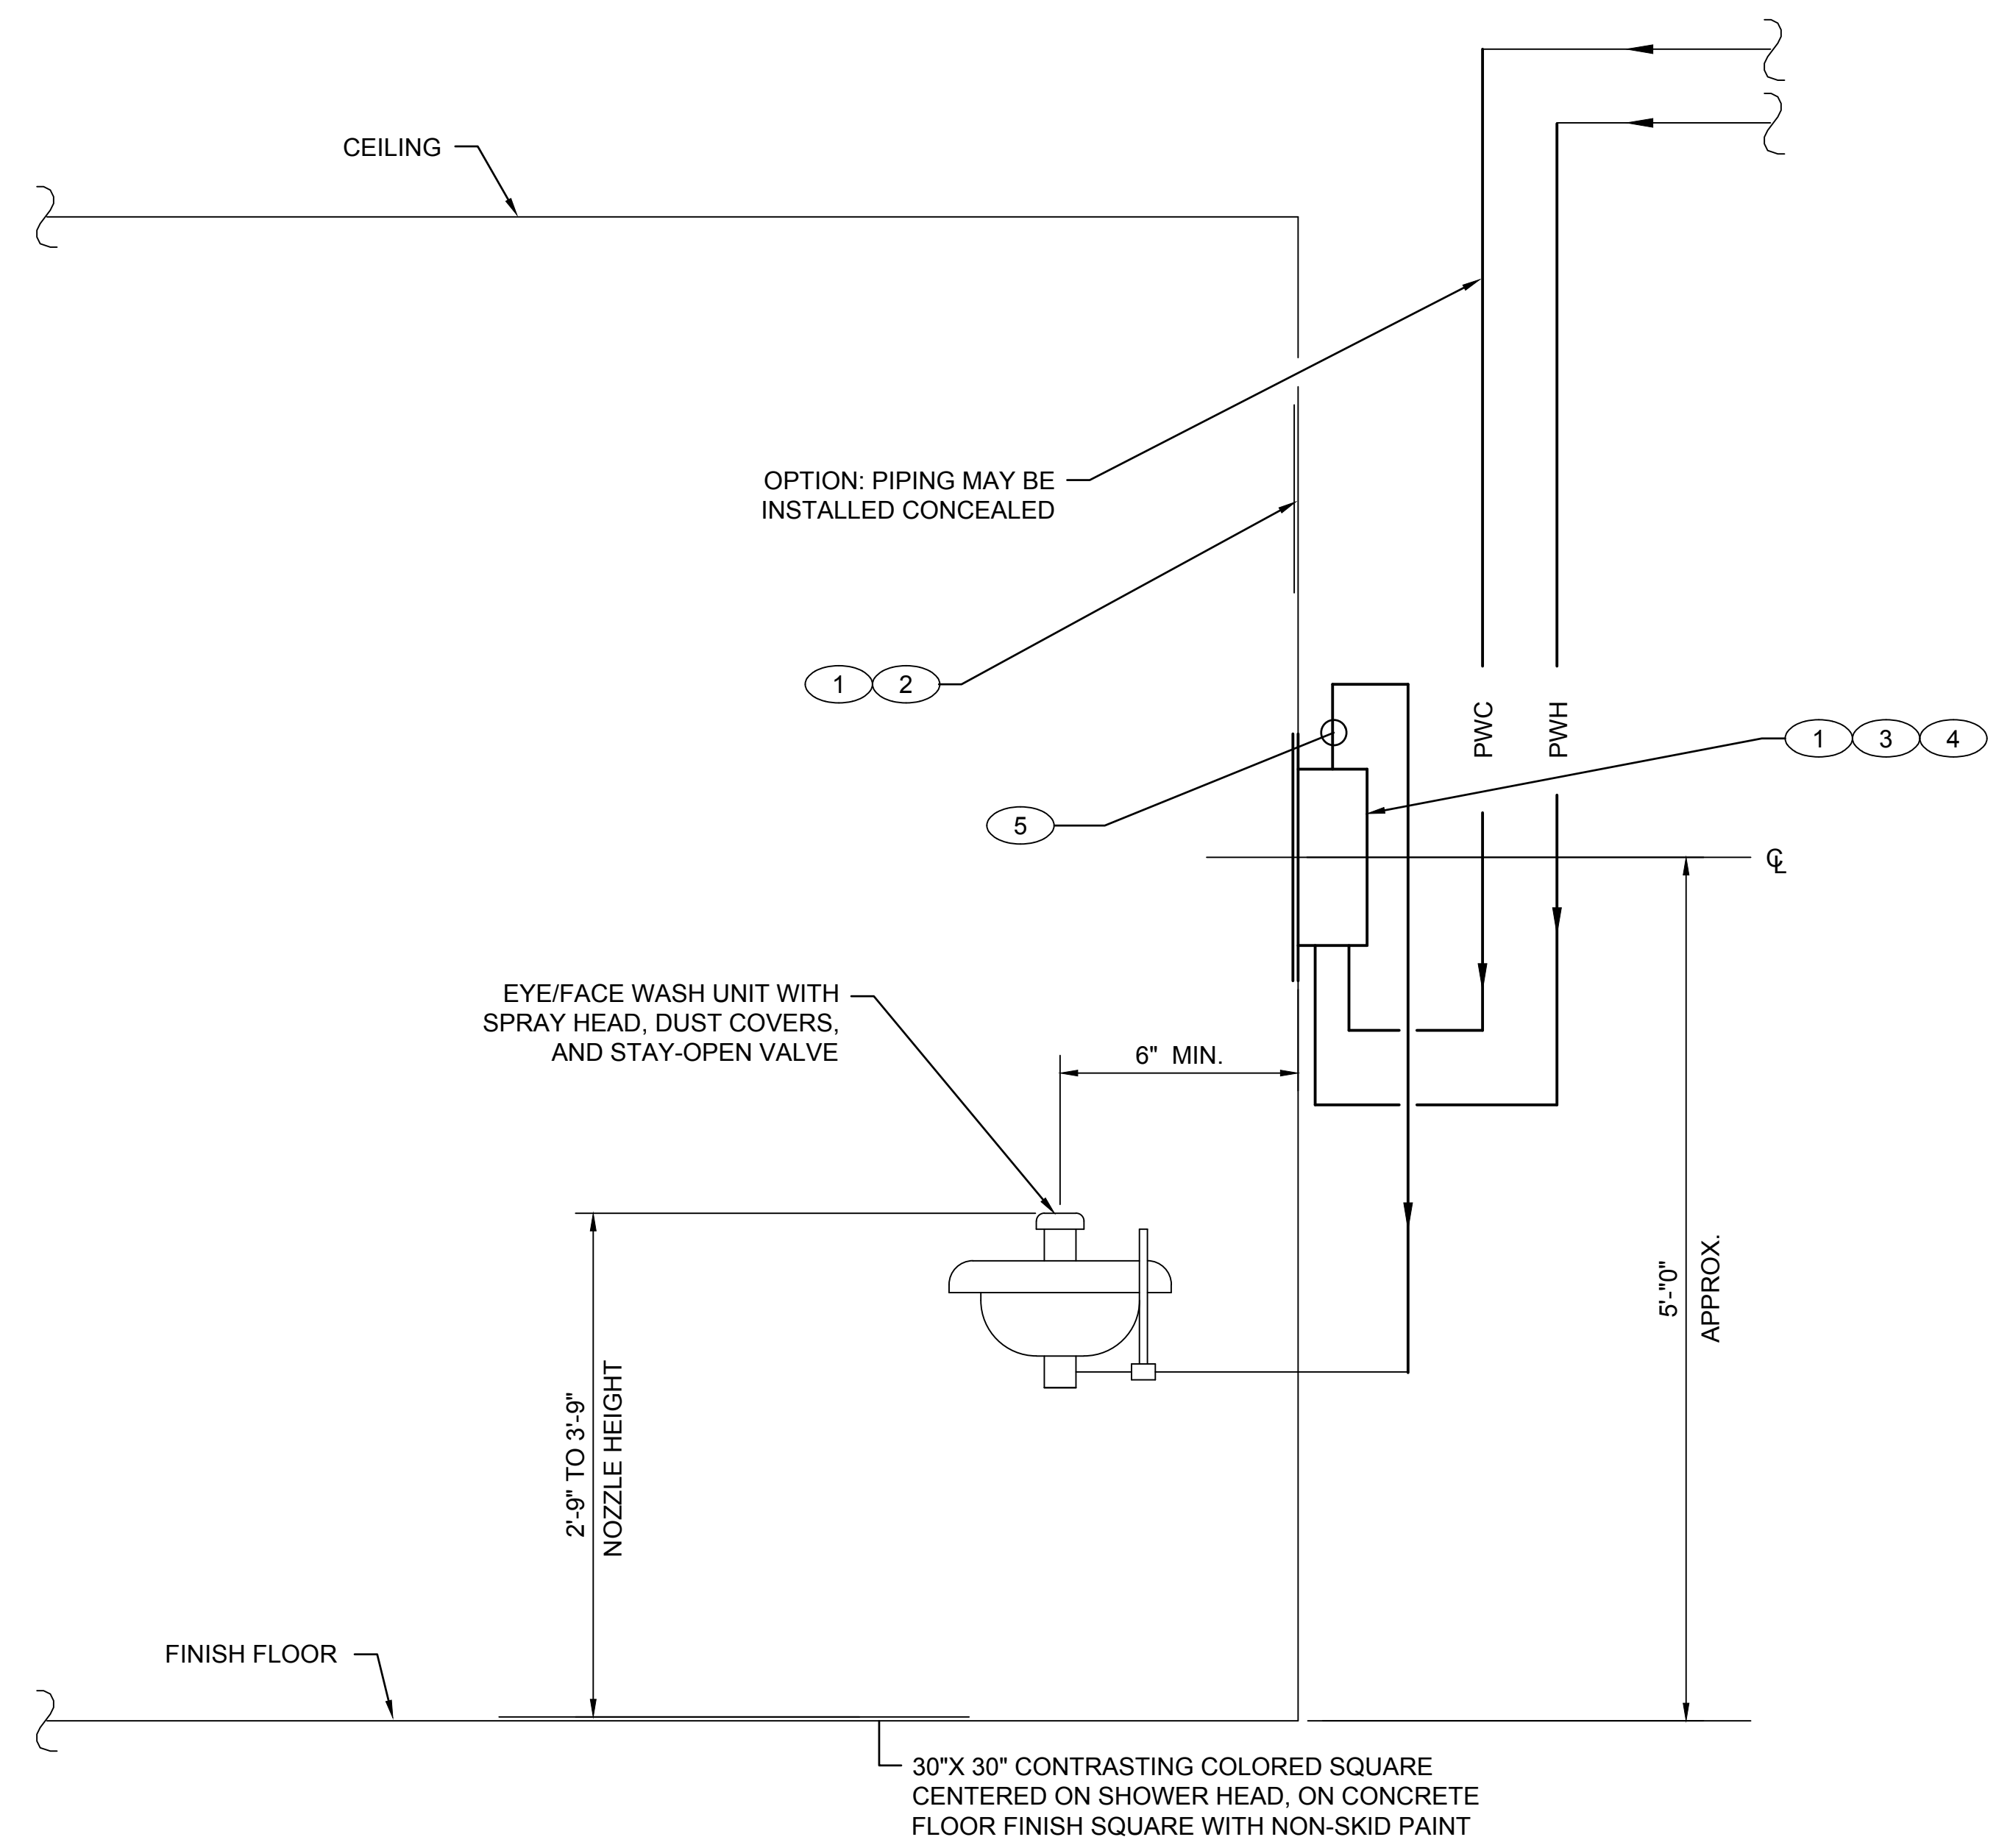

DRAWING DEVELOPED FOR ML-3/ ML-4 PROJECTS. FOR ML-1/ ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

NO	DATE	CLASS REV	DC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
4	06-15-2017	UNCLASS	TO	ADMIN. CHANGES TO CAD STD. REV#5 FORMAT & SHEET NUMBER WAS 3 OF 5	JB	AJ	ML	ML	TO
3	08-14-2003	U	LB	EDITORIAL CHANGES & DWG. NO. WAS ST6000	RP	JM	RR	GG	TO
2	10-25-2002	U	LB	REMOVED THE EYEWASH DRAIN PIPING	RP	JM	RR	GG	TO
1	09-06-2002	U	LB	GENERAL REVISION, ADDED PWH PIPING AND MIXING VALVE.	RP	RR	GG	GG	TO

**EYEWASH DETAIL**  
SCALE: NONE

**NOTES FOR DESIGNER:** (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)

1. SEE SHEET 4.

00% REVIEW  
NOT FOR CONSTRUCTION

**ENGINEERING STANDARDS**

**MECHANICAL**

**EMERGENCY EQUIPMENT DETAIL**

**EYEWASH**

DRAWN	R. PEARSON
DESIGN	R. ROMERO
CHECKED	G. GREWAL
DATE	06-28-99

TA- XX BLDG- XX

SUBMITTED DISCIPLINE POC: GURINDER GREWAL APPROVED FOR RELEASE STANDARDS MANAGER: TOBIN ORUCH

SHEET **3**

**3** OF **4**

D.C.: U REVIEWER: LARRY BAYS DATE: 06-28-99

PROJECT ID DRAWING NO DATE: 06-28-99

**CHAPTER 6** **ST-D2010-1** REV **4**