


D
C
B
A

KEYED NOTES:

1 AUTOMATIC DRAIN VALVE FURNISHED WITH REFRIGERATED DRYER.

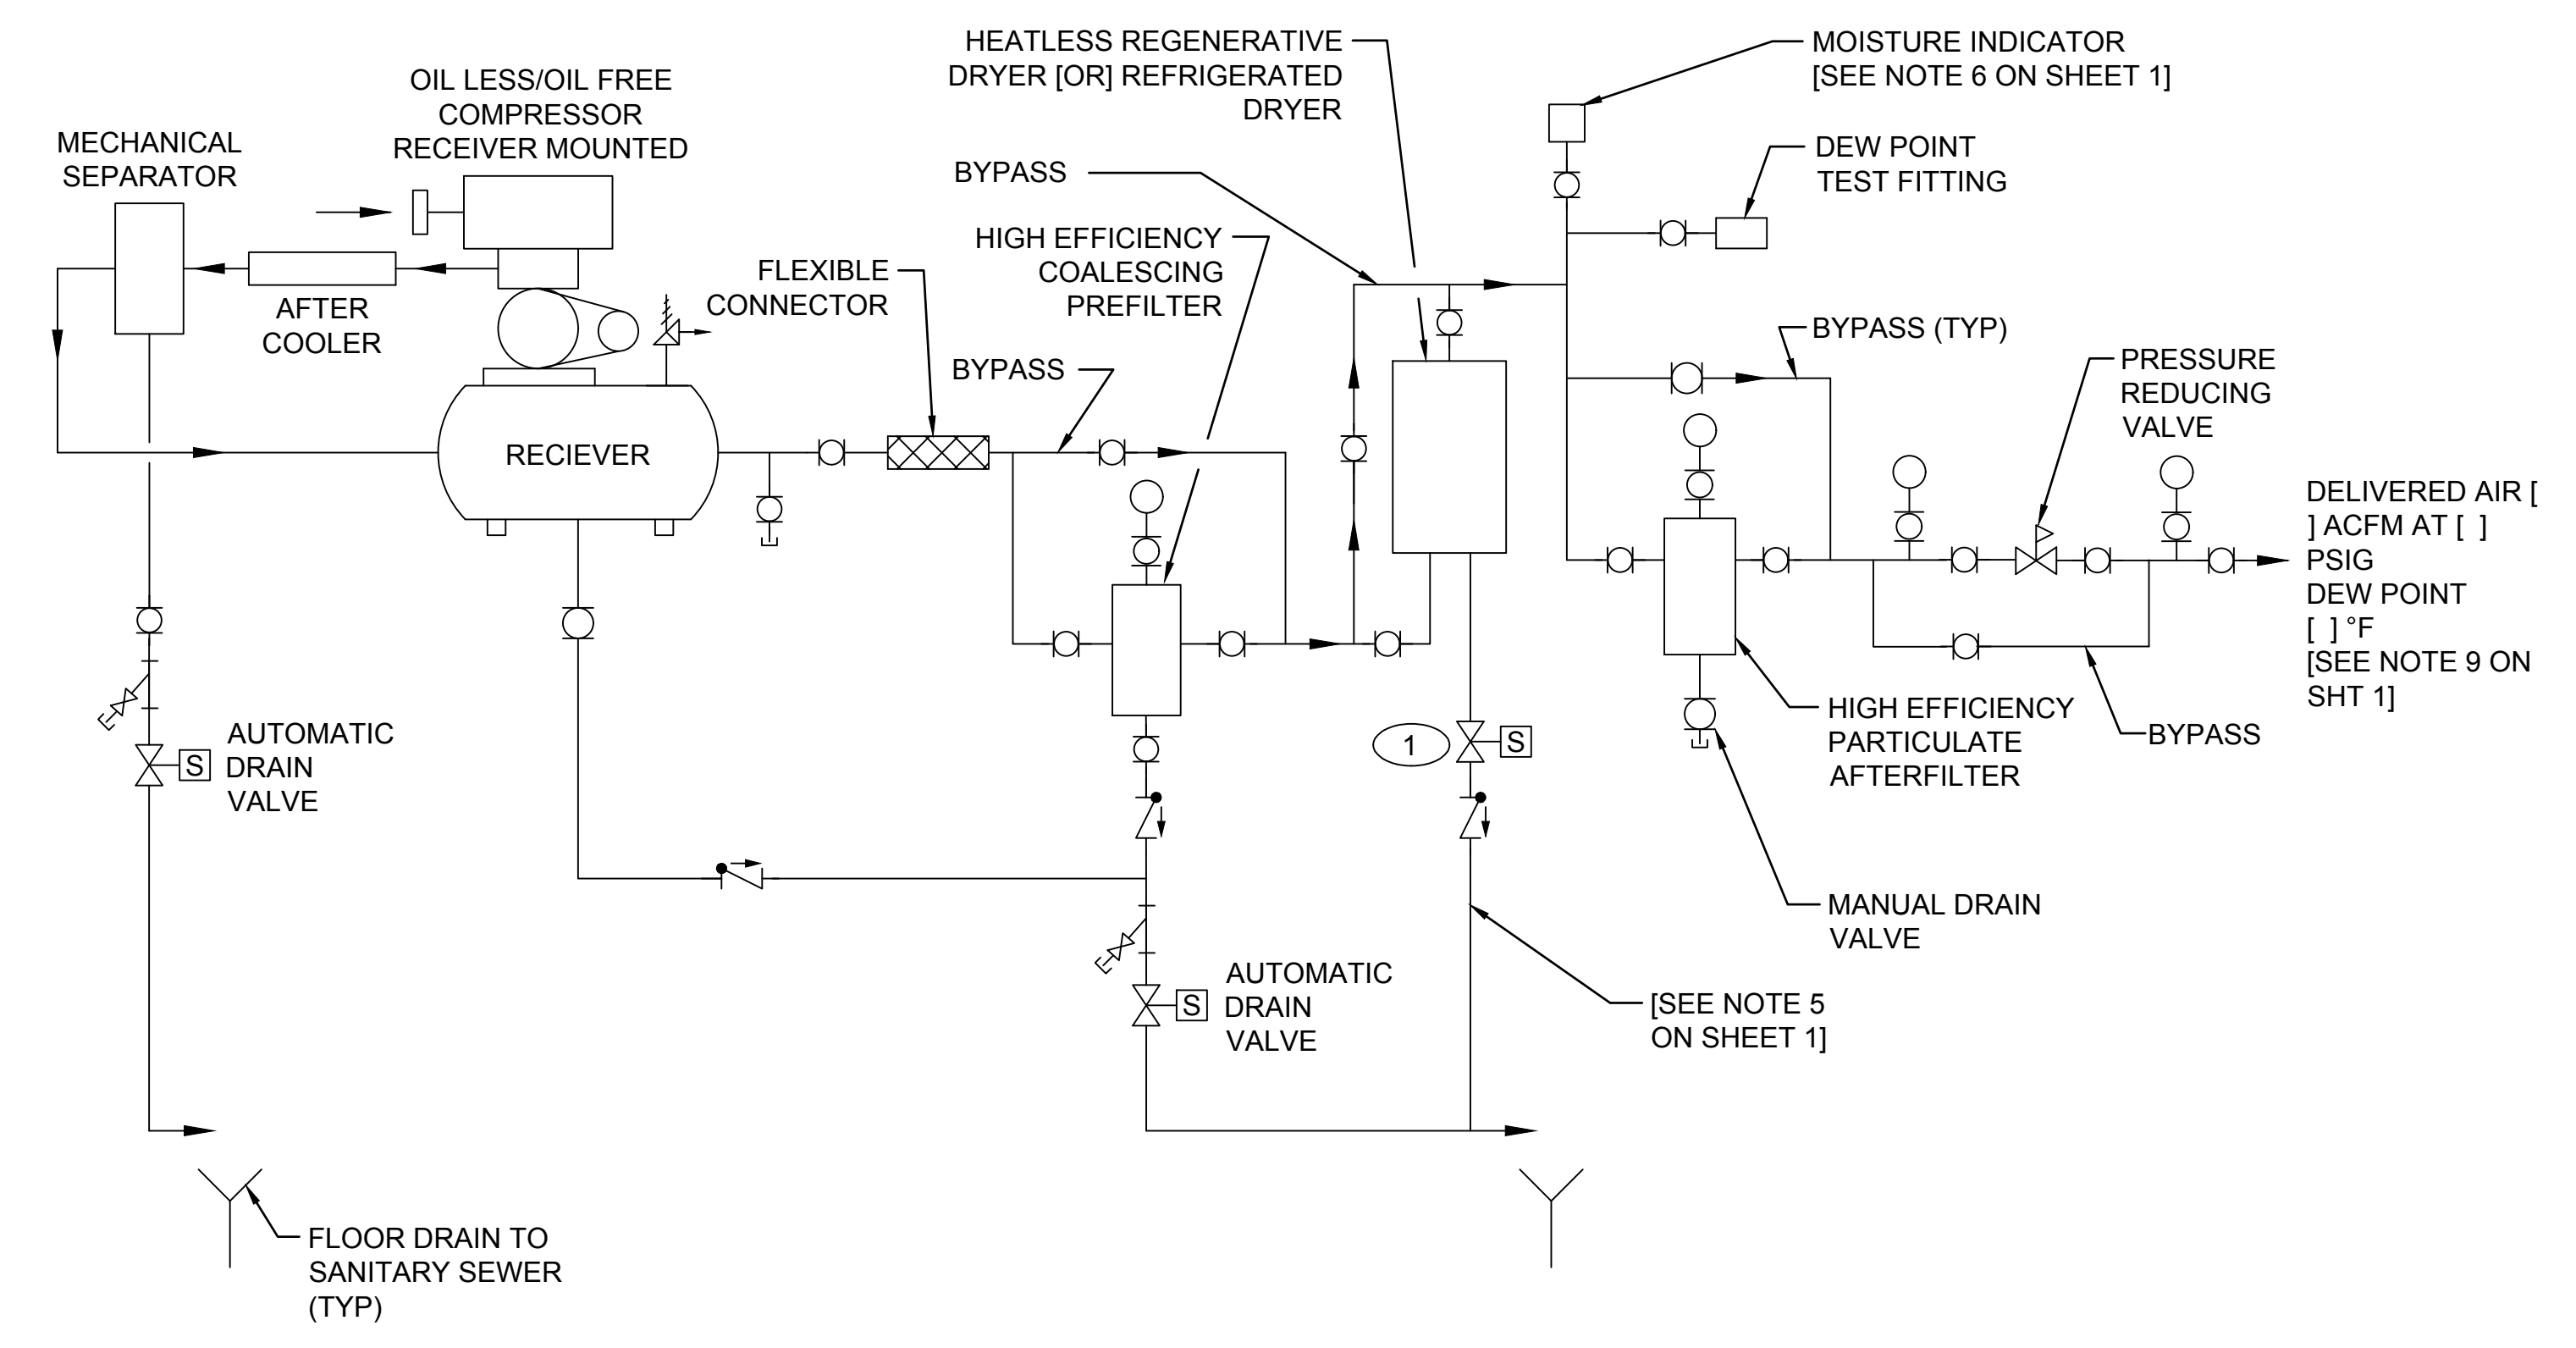

DELIVERED AIR [] ACFM AT [] PSIG
DEW POINT [] °F
[SEE NOTE 9 ON SHT 1]

DRAWING DEVELOPED FOR ML-3/ML-4 PROJECTS. FOR ML-1/ML-2, ADDITIONAL REQUIREMENTS AND QA REVIEWS ARE REQUIRED. (REMOVE THIS NOTE WHEN INSERTED INTO A DRAWING PACKAGE).

COMPRESSED AIR COMPONENT DETAIL
SCALE: NONE

NOTES FOR DESIGNER: (DO NOT INCLUDE ON CONSTRUCTION DRAWINGS)
1. SEE SHEET 1.

NO	DATE	CLASS	DC	DESCRIPTION	DWN	DSGN	CHKD	SUB	APP
4	06-15-2017	UNCLASS	TO	ADMIN. CHANGES TO CAD STD. REV#5 FORMAT	JB	AJ	ML	ML	TO
3	08-13-2003	U	LB	EDITORIAL CHANGES & DWG. NO. WAS ST6020	RP	JM	RR	GG	TO
2	09-06-2002	U	LB	ADDED "ML" NOTE.	RP	JR	GG	GG	TO
1	02-07-2001	U	LB	REVISED FLOW DIAGRAM, NOTES AND ADDED SHEET 3 AND 4	RP	JR	RR	TO	TO

ENGINEERING STANDARDS

MECHANICAL				DRAWN	R. PEARSON
COMPRESSED AIR COMPONENT DETAIL				DESIGN	J. RATLIFF
OIL LESS/OIL FREE COMPRESSOR, RECEIVER MOUNTED				CHECKED	R. ROMERO
TA- XX		BLDG- XX		DATE	06-28-1995
SUBMITTED DISCIPLINE POC: GURINDER GREWAL			APPROVED FOR RELEASE STANDARDS MANAGER: TOBIN ORUCH		
				2	
Los Alamos National Laboratory PO Box 1663 Los Alamos, New Mexico 87545				2 OF 4	
D.C.: U	REVIEWER: LARRY BAYS	DATE: 06-28-1999			
PROJECT ID	DRAWING NO		REV		
CHAPTER 6	ST-D2090-1		4		

00% REVIEW
NOT FOR CONSTRUCTION